

Installation Instructions

Descriptions

The luminaire contains a constant-current driver and LED module(s). It works under technical conditions as the product labels indicate. Its modular design makes it convenient to replace whichever of the modules that failed.

Technical Parameter

LED Garden Light	
Module Quantity	1
Power	60W
Input Voltage	<input type="checkbox"/> 100~240V <input type="checkbox"/> 100~277V <input type="checkbox"/> 220~240V <input type="checkbox"/> 120~277V <input type="checkbox"/> 277~480V <input type="checkbox"/> Other____
Power Factor	0.95
Working Environment	-40°C~+45°C, 10%~90%RH
Bolt Torque	17Nm
Mounting Height	6~9m
Mounting Spacing	12~18m
Dimensions	475x440x520mm
Net Weight	6.6kg
Project Area	0.209m ²
Degree of Protection	<input type="checkbox"/> IP54 <input type="checkbox"/> IP65 <input type="checkbox"/> IP66 <input type="checkbox"/> IP67 <input type="checkbox"/> Other____


Notes: The above net weight is typical value. The power above are maximum rated power of the model subject to tolerance of 10%.

Applications


Garden, sub-trunk road, factory, schoolyard, park, residential area, courtyard, etc.

Installation and Maintenance


Installation




1. Install the Y-shaped bracket with four M6 screws from the package.



2. Fasten the M6 screws for the bracket. Fixate the driver input cable onto the arm along its cable trough, and thread through the bottom.




3. Connect the wires to AC input properly. Loosen the M8 screws on bracket at the bottom.




4. Mount the fixture onto the post. Fasten the M8 screws. Installation finished.

Remarks: the above procedures are for arm-unassembled packaging; for fully-assembled packaging, installation starts from step 3.


Maintenance




1. Power off. Undo the screws on the top to open the cover.



2. Undo the screws on the failed module, and disconnect its cable. Replace it with a new module.




3. Adjust the supporting rod from status as Pic.1 shows above to status in Pic.2. Close the cover.




4. Fasten the screws. Maintenance finished.

Installation Instructions

Cable Connectors



1. Connect the male and female connectors by aligning the indicative arrow on them.



2. Hold the nut on one terminal still, meanwhile, rotating clockwise till the one on the other terminals is tightened up. Otherwise the waterproof performance might be affected.

Wiring

Power Supply End	Earth wire	Neutral wire	Live wire
Fixture End	Yellow-green lead	Blue lead	Brown lead
	Green lead	White lead	Black lead

Caution

- a** Disconnect or turn off power before installation, maintenance and wiring.
- b** Cable connection must be insulated and waterproof.
- c** For luminaires with glass cover: the cover is made of tempered glass which shatters into small pieces without sharp edges when it breaks. Application condition: -30°C~100°C; maximum temperature rise $\Delta t \leq 60^\circ\text{C}$.
- d** The light source of this luminaire is not replaceable. When the light source's lifetime comes to an end, it is the whole luminaire that should be replaced.


Warning: Danger! Electric shock risk!

(via IEC 60417-6042 (2011-11))




For luminaires with glass cover: The broken cover should be replaced.

Rectangle



Round

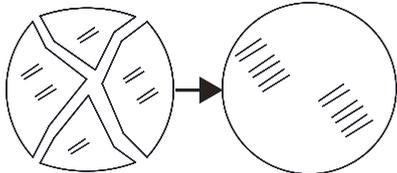

The luminaire shall be installed by a qualified electrician and wired in accordance with the latest IEE electrical regulations or the national requirements.



This marking indicates that this product should not be disposed with other household wastes throughout the EU. To prevent possible harm to the environment or human health from uncontrolled waste disposal, recycle it responsibly to promote the sustainable reuse of material resources. To return your used device, please use the return and collection systems or contact the retailer where the product was purchased. They can take this product for environmental safe recycling

Remarks

1. This luminaire uses permanent connection on power supply with flexible cable and wires (60245 IEC57). Sufficient length of cable is reserved for connection to AC power. Protection over the connection joint and elimination of tensile force there should be ensured.
2. This luminaire uses type Z attachment: the external flexible cable or cord of this luminaire cannot be replaced; if the cord is damaged, the luminaire shall be destroyed.
3. Wiring: the connection to AC power should be operated on terminal blocks in a wiring box with a degree of protection at least equivalent to the luminaire, and there should be devices to fixate wires.
4. The luminaire can be mounted onto ordinary combustible surfaces.